



HIPOWER Sound Attenuated Enclosures Specifications

HIPOWER SYSTEMS offer a variety of enclosure designs to meet customer’s needs. From mobile units to standby generators, we make sure each Enclosure has the HIPOWER quality name to it.

Table 1 provides general information about Enclosure specifications. (Table 1 does not apply to 20’ containers)

Enclosure Specification:

Description	Material/Process Identification	
Enclosure Structure	Frame Material	HRPO Steel
	Enclosure Material	HRPO Steel
Enclosure Insulation & Soundproofing	Polyurethane Foam (Black) / Technical data p.4 (GAS RANGE) Rock Wool (Volcanic) (DIESEL RANGE)	
Coating / Finish	Enclosure & Frame Finish	Powder Coating / Technical data p.11

Table 1

Each Enclosure design has either a lifting eye on top of the Enclosure or an opening for forklift access on the bottom of the Enclosure. On each side of the generator, there are access door which allows users to obtain access to oil filters, oil drains etc. Each door is held in place by stainless steel hinges with rubber joints. The access doors can be locked using provided keys (depending on style of unit) with the unit to ensure safety. Some models have a see through window to view the control panel. The control panel Enclosures are NEMA 2 rated.

The exhaust system uses aluminized piping to prevent corrosion. On the outlet side of the exhaust, rain caps are installed to prevent foreign particles from entering the exhaust system. To ensure rusting does not occur on the outside of the generator, the process of powder coating has been implanted. Salt tests have been conducted on our powder coating canopies and have exceeded 1,000 hours of salt spray tests (P.9). All of our Enclosure designs are fireproof and waterproof.



The Enclosure is soundproofed using insulation material. Currently our standard materials used in our units are listed in Table 1. Each unit has different dBA ratings. Please refer to that specific unit catalog for further information.

Easy access to radiator fills through opening on the roof of the enclosure. The roof is fitted with a flange to assure a full access to radiator filling cap and maintenance. Emergency stops are present on the outside of the Enclosure as well as on the inside of the Enclosure on the control panel. The control panel is situated inside the Enclosure structure to assure full protection.

We provide winter packages for generators that are exposed to extreme climate conditions. Table 2 provides basic information about winter package accessories.

Shutter System w/ actuator (NEMA 3 rated)	Hydraulic Shutter System: Operates by sensing temperature of coolant in the engine/radiator system.
	Electric Shutter System: Operates by sensing surrendering temperature inside the Enclosure.
Snow Hood	Prevents snow from entering the generator. Available for both Inlet & Outlet side.
Engine Block Heater	Electric Block Heater: Heats coolant in the engine/radiator system using electricity. Has internal thermostat to maintain a range of temperature.
	Hydronic Block Heater: Heats coolant in the engine/radiator system using diesel fuel.
Battery Blanket	Provides warmth to the battery package.
Space heater inside control panel	The space heater maintains the right temperature inside the control panel Enclosure.
Bent Exhaust Outlet	The outlet exhaust piece is bent to prevent snow from accumulating on the exhaust top.
Shut Down Valve	Provides safety in hazardous areas when positive air is achieved in the system.

Table 2

Enclosures are wind rated to 180 mph. There are four different frame structures we provide with our Enclosure designs:

- Open Bottom Frame Structure
- Closed Bottom Frame Structure
- Skid Frame Structure
- Trailer Mounted Structure



Table 3 provides information of type of application used.

Frame Style	General Use
Open Bottom Frame Structure	Mainly used for standby application, to mount external fuel tank on the bottom of the generator.
Closed Bottom Frame Structure	Mainly used for standby application. Closed bottom frames provide leak proof structures from contaminates presented from the engine and other components inside the enclosure.
Rental Skid Frame Structure	Used for rugged terrains. Contains internal fuel tank. Skid frames provide leak proof structures from contaminates presented from the engine and other components inside the enclosure.
Trailer Mounted Structure	All three types of structures listed above can be mounted on trailers to provide mobility.

Table 3



HIPOWER®

Start of Technical Data of Polyurethane Foam

PRODUCT DESCRIPTION: 1 inch thick polyether foam with black urethane facing hot rolled laminated

FOAM

Physical Property	Description - Value	Tolerance	Test Standard
Material	Polyether Polyurethane Foam	NA	NA
Color	Charcoal	NA	NA
Density	1.8 lb/cf	+ - 0.18	ASTM D3574
Elongation	140%	minimum	ASTM D3574
Tensile Strength	12.0 psi	minimum	ASTM D3574
Tear Strength	1.00 pli	minimum	ASTM D3574
Compression Set @ 50%, 22 Hours	5% typical		ASTM D3574 Test D
Pores per inch	60-70 typical		
Thermal Conductivity	0.27 BTU-in/(Hr-ft ² -°F) typical	0.01	
Flammability	MVSS302, UL-94 HF-1		

FACING

Physical Property	Description - Value
Material	Polyurethane
Thickness	0.002 inch
Color	Black

AVAILABLE SIZES

Roll	54" X 100'
Sheet	As Specified

THE VALUES PRESENTED ARE TYPICAL AND ARE NOT INTENDED FOR SPECIFICATION PURPOSES. This information is provided without warranty, representation, inducement or license of any kind. INCLUDING BUT NOT LIMITED TO THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR USE OR PURPOSE, except that it is accurate to the best of Technicon Industries' knowledge or obtained from sources believed by Technicon Industries to be accurate, and Technicon Industries does not assume any legal responsibility for the use or reliance upon same. Customers are encouraged to conduct their own tests for suitability and conformance.



HIPOWER®


ABSORPTION COEFFICIENT AND NRC to ASTM E1050

1/3 octave (Hz)	Absorption
63	0.02
80	0.03
100	0.04
125	0.03
160	0.06
200	0.07
250	0.09
315	0.09
400	0.14
500	0.18
630	0.22
800	0.32
1000	0.42
1250	0.51
1600	0.62
2000	0.76
2500	0.85
3150	0.83
4000	0.71
5000	0.60
6300	0.65
NRC	0.36



HIPOWER[®]

**ASTM E1050
Normal Incidence Absorption
AF-021-40-UB**

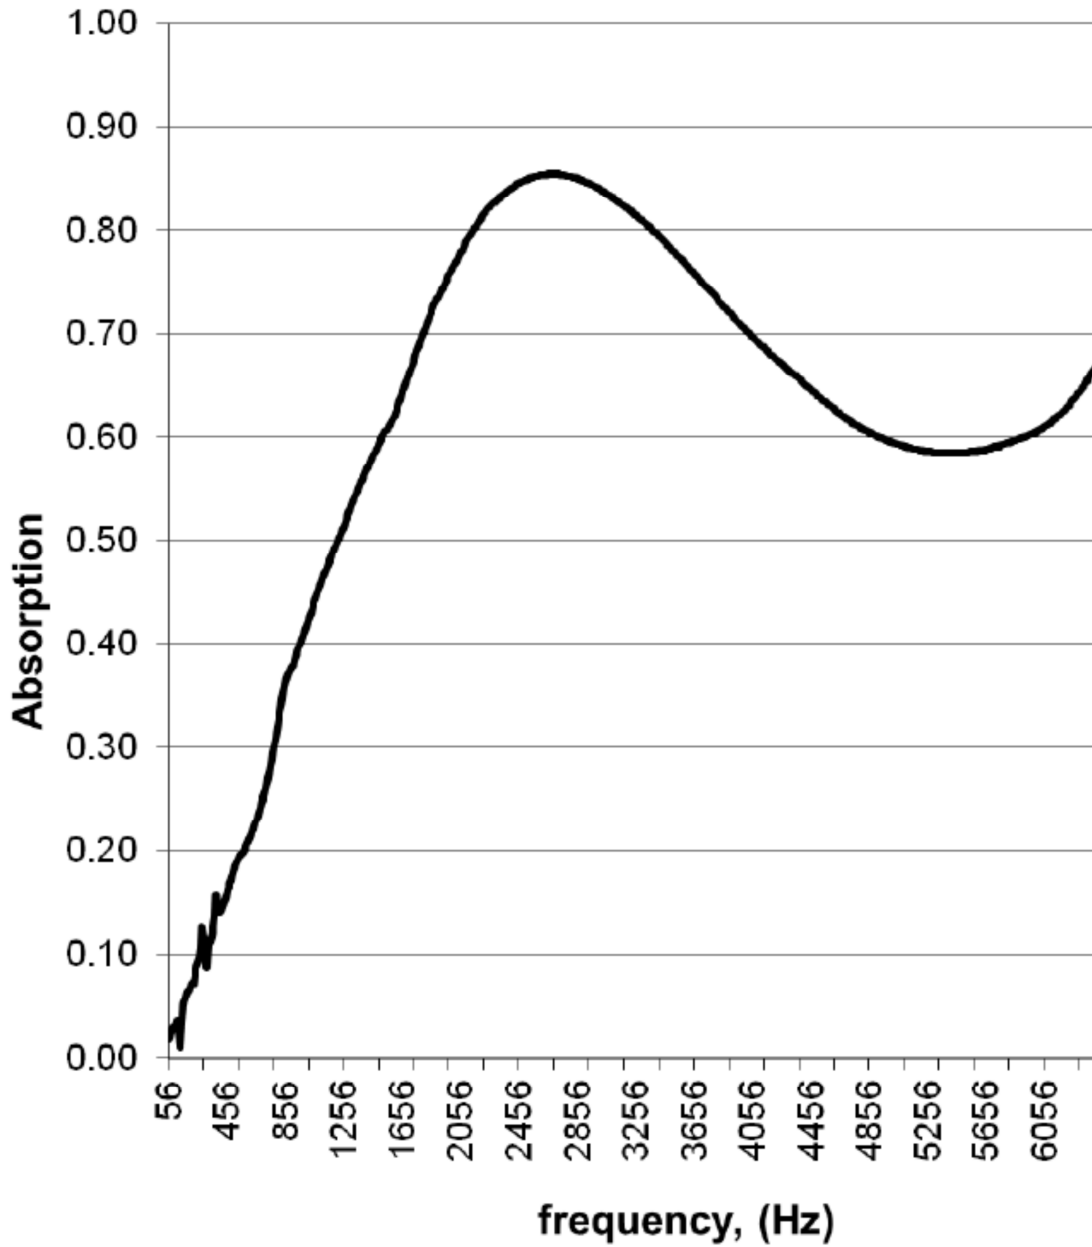




HIPOWER®

ABSORPTION COEFFICIENT, NRC and SAA to ISO 354

Frequency	Sound Absorption Coefficient
(Hz)	α_s
100	0.11
125	0.06
160	0.10
200	0.13
250	0.24
315	0.30
400	0.43
500	0.49
630	0.66
800	0.76
1000	0.88
1250	0.93
1600	0.97
2000	0.94
2500	0.90
3150	0.86
4000	0.82
5000	0.90
NRC	0.64
SAA	0.64



HIPOWER[®]

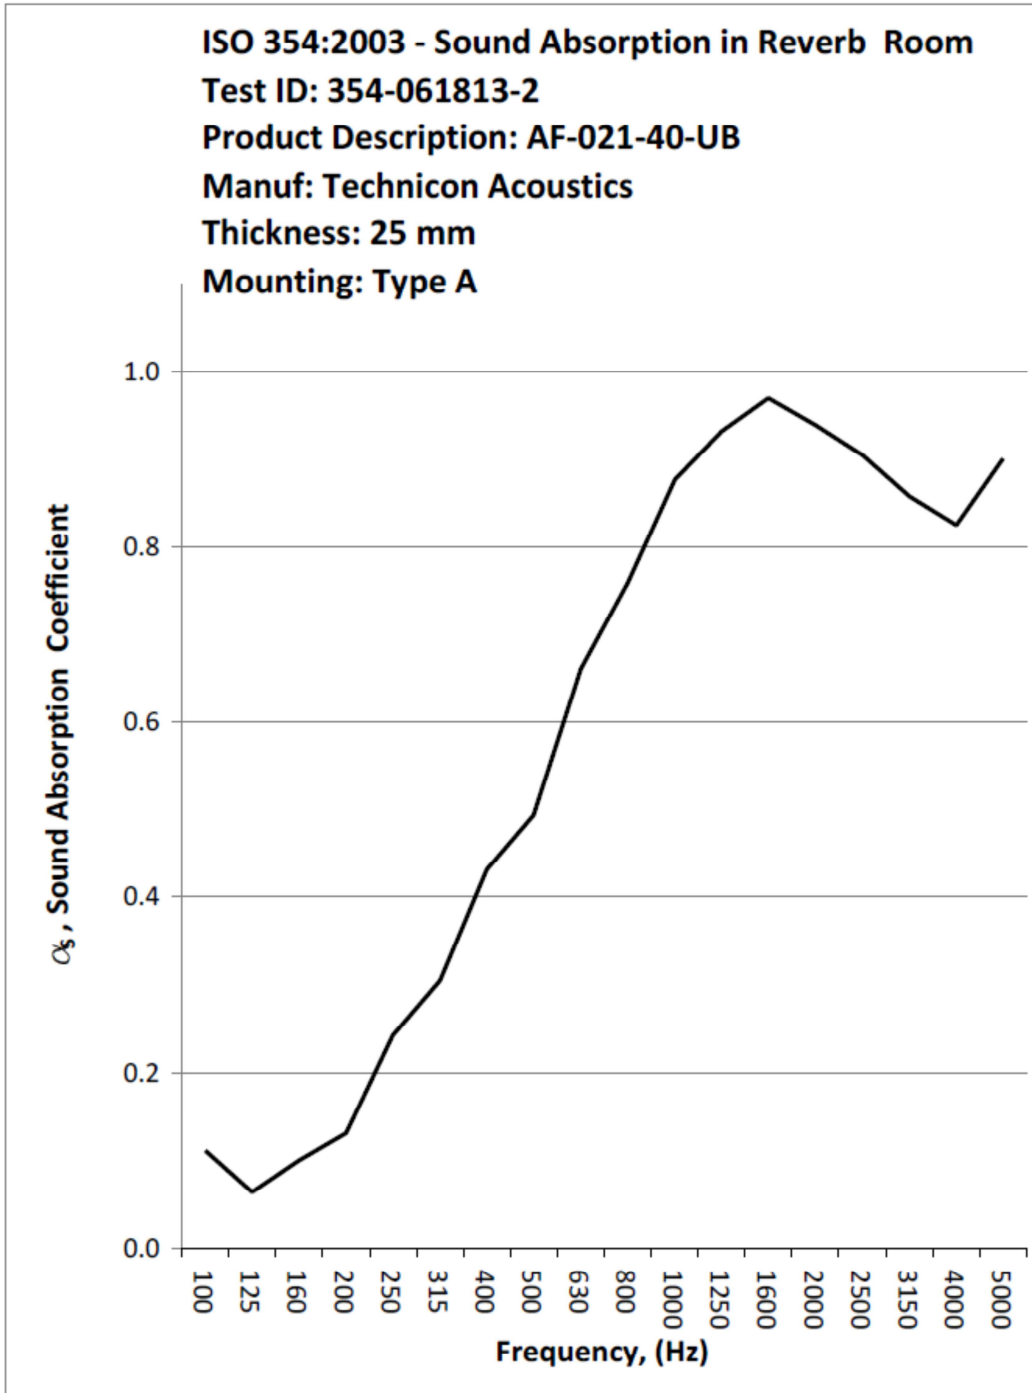

End of Technical Data of Polyurethane Foam

Start of Technical Data of Salt Spray Test



Technologies

LABORATORY REPORT

PHOSPHATING LINE

Customer: HIMOINSA

CORROSION TEST (PRE-TREATMENT + PAINT):

Type of test: Neutral Salt Spray according to the Norms ASTM B-117-07 / UNE-EN ISO 7253	
Substrate / Colour of paint	Steel / Red
Thickness (µm):	100
Delamination degree (d) (mm)(288 h)	< 0,5
Corrosion degree (c) (mm)(288 h)	< 0,5
Delamination degree (d) (mm)(624 h)	< 0,5
Corrosion degree (c) (mm)(624 h)	< 0,5
Delamination degree (d) (mm)(1000 h)	< 0,5
Corrosion degree (c) (mm)(1000 h)	< 0,5
Blistering (1000 h)	0

Blistering: Norm ASTM D 714-56

D: dense MD: medium dense M: medium F: low 0: nothing

Test conditions (ASTM-B 117-07/ UNE-EN ISO 7253):

Panels rack: plastic, 20° angle.

Temperatura of the cabinet: 35 ± 2 °C

Salt solution: 50 ± 5 g/l de NaCl in deionized water.

pH of the salt solution along the test: 7,03

Average condensed salt solution along the test: 1,53 ml / hour.

Evaluation:

UNE-EN ISO 4628-8:

Delamination degree (d) = $(d_1-w)/2$, where: d_1 : average value of total delamination (mm) ; w: initial cut (0,5 mm)

Corrosion degree (c) = $(w_c-w)/2$, where: w_c : average value of total corrosion; w: initial cut (0,5 mm)

HENKEL IBÉRICA S.A. / DIVISION ST
 LABORATORIO APLICACIÓN Y DESARROLLO
 Vial Norte, 1 - 08170 - Montornés del Vallés (Barcelona)
 Tel. (93) 290.40.55 - Fax. (93) 290.41.81



Type of tests: Adhesión & Impact according to the Norms ISO 2409 / UNE-EN ISO 6272	
Substrate / Colour of paint	Steel / Red
Thickness (µm):	100
Adhesión:	0
End point of failure by impact (*) (cm.)	100

(*): Intrusion.

Adhesion: Norm ISO 2409					
0: clean borders	1: 5 % loss	2: 5-15 % loss	3: 15-35 % loss	4: 35-85 % loss	5: 100 % loss

Impact resistance: Norm UNE-EN ISO 6272
End point of failure by impact: Maximum height from where the paint is not damaged.
Weight: 1 kg.
Spheric ball: Ø 12,5 mm

End of Technical Data of Salt Spray Test